

ACA vzw - Erkend Controle Organisme
 Meensesteenweg 336 - 8500 Roeselare
 BTW BE 0911 407 899
 Tel: 05120 00 02 - Fax: 05120 10 02
 info@acavzw.be - www.acavzw.be

Plaats van de elektrische installatie


Klant Horemans interieur BVBA
 Parklaan
 8434 Westende
 20220 800 3328
 25/08/2022

Installateur

De Winter Bert
 Ekelenberg 46
 2200 Herentals
 GSM: 0496 53 01 44
 e-mail: Dewinterbert@outlook.com
 0 701 596 248

p. 2/4
 Situatieschema
 3 x 400V + N - 50Hz

Schema's getekend door: De Winter Bert Barabas - BTW BE 0568.638.477

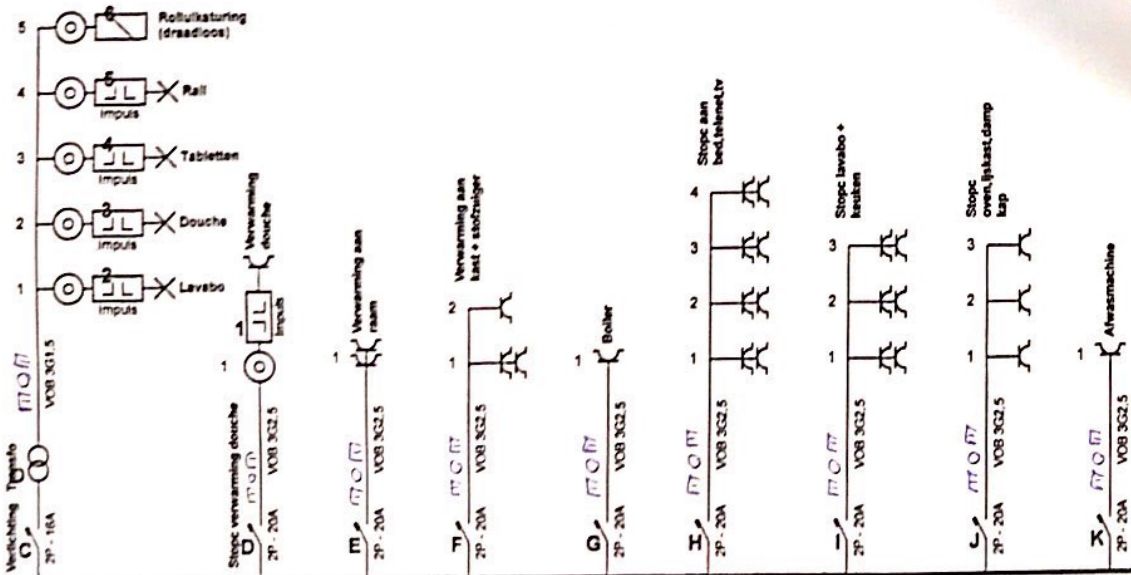

Hoofddiff Bijkomend diff
 A B
 130mA 130mA - 3kA
 AP - 63A AP - 40A

25/08/2022
 202208003328



ACA vzw - Erkend Controle Organisme
 Meensesteenweg 336 - 8500 Roeselare
 BTW BE 0911 407 899
 Tel: 05120 00 02 - Fax: 05120 10 02
 info@acavzw.be - www.acavzw.be

Plaats van de elektrische installatie

Klant Horemans interieur BVBA
 Parklaan
 8434 Westende

Installateur

De Winter Bert
 Ekelenberg 46
 2200 Herentals
 GSM: 0496 53 01 44
 e-mail: Dewinterbert@outlook.com
 0 701 596 248

p. 1/4
 Eendraadschema
 3 x 400V + N - 50Hz

Schema's getekend door: De Winter Bert Barabas - BTW BE 0568.638.477